



75  
आज़ादी का  
अमृत महोत्सव

**MUNICIPAL CORPORATION OF DELHI**  
**OFFICE OF THE DEPUTY HEALTH OFFICER**  
**PUBLIC HEALTH DEPARTMENT**  
**GREEN PARK, AURBINDO MARG,**  
**NEW DELHI-110016**



NO. DHO/SZ/MCD/2024/D-267


Dated: 14/5/2024

**SCHOOL HEALTH CERTIFICATE**

It is certified that an inspection team headed by Sh. Kailash Kumar, Assistant Public Health Inspector from Public Health Department, South Zone inspected the Mount Columbus School, located at C Block, Dakshinpuri, New Delhi-110062, on 13/05/2024. It was found that the School has safe drinking water facilities for the students and members of staff of the institution and is maintaining the hygienic sanitation condition in the school building and the campus.

The above certificate is valid for one year from date of issue.

  
14/05/24  
Deputy Health Officer  
South Zone

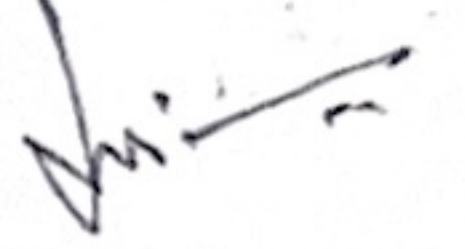

Copy to: -

- Principal  
Mount Columbus School,  
C Block, Dakshinpuri,  
New Delhi-110062



Principal  
Mount Columbus School  
C-Block, Dakshinpuri  
New Delhi-110062



# SHREE RAM TESTING LABORATORIES

ISO 14001 : 2015 & ISO 9001 : 2015 Approved Laboratory

Lab: A-2/103, Site-V, UPSIDC Industrial Area, Kasna, Greater Noida-201306

H.O. 223, 2nd Floor, Living Style Mall, Jasola, New Delhi-110025

Mob: 9953984801, 9717160780, 9999024801, E-mail: stl.noida@gmail.com

E-mail: info@shreeramlab.com, shreeramlab@yahoo.com, Website: www.shreeramlab.in

Complete Analytical Solution  
ISO 14001 : 2015 & ISO 9001 : 2015 Certified

## TEST REPORT

<b>Issued to:</b> M/S Mount Columbus School G6CP+339, Block C, near Mahila Mangal, Dr.Ambedkar Nagar, Block A, Sector 5, Dakshinpuri, New Delhi, Delhi 110062	<b>Report No.</b>	W-140524-01
	<b>Report date:</b>	14/05/2024
	<b>Sample Received:</b>	13/05/2024
	<b>Analysis date:</b>	13/04/2024 to 14/04/2024
	<b>Sampled By:</b>	customer

**Sample Description:** Drinking Water

**Received Sample in Sealed and marked Plastic Bottle**

P- 1/1

## RESULT

**Drinking Water-Essential Tests as per IS 10500:2012**

S.No.	Parameters (Units)	Test Method	Results	Requirement as per IS: 10500-2012
1.	Odour	IS:3025(P-5) 2018	Unobjectionable	Unobjectionable
2.	Taste	IS:3025(P-8) 1984 (RA- 2017)	Agreeable	Agreeable
3.	Colour (Hazen)	IS:3025(P-4) 2021	<1.0	5 max
4.	Turbidity (NTU)	IS:3025(P-10) 1984 (RA- 2017)	Nil	1 max
5.	pH value (at 25 °C)	IS:3025(P-11) 1983 (RA- 2017)	7.75	6.5 to 8.5
6.	Total Dissolved solids (mg/l)	IS:3025(P-16) 1984 (RA- 2017)	103	500 max
7.	Total Hardness (as CaCO <sub>3</sub> ) (mg/l)	IS 3025 P-21:2009 (RA- 2019)	64.13	200 max
8.	Chloride (as Cl) ) (mg/l)	IS:3025(P-32) 1988 (RA- 2019)	28.24	250 max
9.	Iron (as Fe) (mg/l)	IS:3025(P-53) 2003 (RA- 2019)	0.01	0.3 max
10.	Residual Free Chlorine(mg/l)	IS:3025(P-26) 2021	Nil	0.20 max
11.	Fluoride (as F) (mg/l)	APHA 4500 (D)	0.012	1.0 max
12.	Total Alkalinity (as CaCO <sub>3</sub> ), (mg/l)	IS:3025(P-23)- 1986 (RA- 2019)	82.38	200 max
13.	Magnesium (as Mg), (mg/l)	IS:3025(P-46)- 1994 (RA- 2019)	5.76	30 max
14.	Aluminum (as Al) ( mg/l)	IS:3025(P-55)- 2003 (RA- 2019)	Not Detected	0.03 max
15.	Zinc (as Zn), (mg/l)	IS:3025(P-49)- 1994 (RA- 2019)	0.01	5 max
16.	Lead (as Pb), (mg/l)	IS:3025(P-47)- 1994 (RA- 2019)	Not Detected	0.01 max
17.	Mercury (as Hg), (mg/l)	IS:3025(P-48)- 1994 (RA- 2019)	Not Detected	0.001 max
18.	Total Arsenic (as As), (mg/l)	IS:3025(P-37)- 1988 (RA- 2019)	Not Detected	0.01 max
19.	<b>MICROBIOLOGICAL PARAMETERS</b>			
i	Coliform (cfu/100ml)	IS 1622:1981 (RA- 2019)	Absent	0 max
ii	E. Coli (cfu/100ml)	IS 1622:1981 (RA-2019)	Absent	0 max

**Remark:** The Tested Parameters meet as per BIS specification.

\*\*\*\*\*

**END OF REPORT**

TESTED BY

Principal

Mount Columbus School

C-Block, Dakshinpuri

SHREE RAM TESTING LABORATORIES  
Technical Manager  
S.K. Tiwari  
AUTHORIZED SIGNATORY

